


**EAST COAST GRID**

<b>INSTALLED CAPACITY</b>		417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	417.9	
<b>ON LINE CAPACITY</b>		171	137	119	119	119	119	119	209.3	203.7	241	243.2	258.2	258.2	258.2	258.2	258.2	258.2	258.2	256.4	256.4	256.4	248.4	215.3	195	
<b>DEMAND</b>		208.15	204.3	191.71	191.09	186.11	188.82	174.28	216.57	225.57	235.82	232.18	241.05	228.34	237.5	238.98	237.1	236.37	238.14	249.54	249.68	249.2	249.41	231.96	221.22	
<b>OPERATING RESERVE</b>		-37.15	-67.3	-72.71	-72.09	-67.11	-69.82	-55.28	-7.27	-21.87	5.18	11.02	17.15	29.86	20.7	19.22	21.1	21.83	20.06	6.86	6.72	7.2	-1.01	-16.66	-26.22	
East Cost		21581.4	17924.3	14666.9	14491.9	14387.3	14521.9	14792.6	26233.3	27346.6	32538.9	34352	33028.1	32600.9	35251.9	34641.1	34797.4	33351.4	31061.9	34431.9	34857.3	34221.8	33169.9	29219.9	23732.4	398441

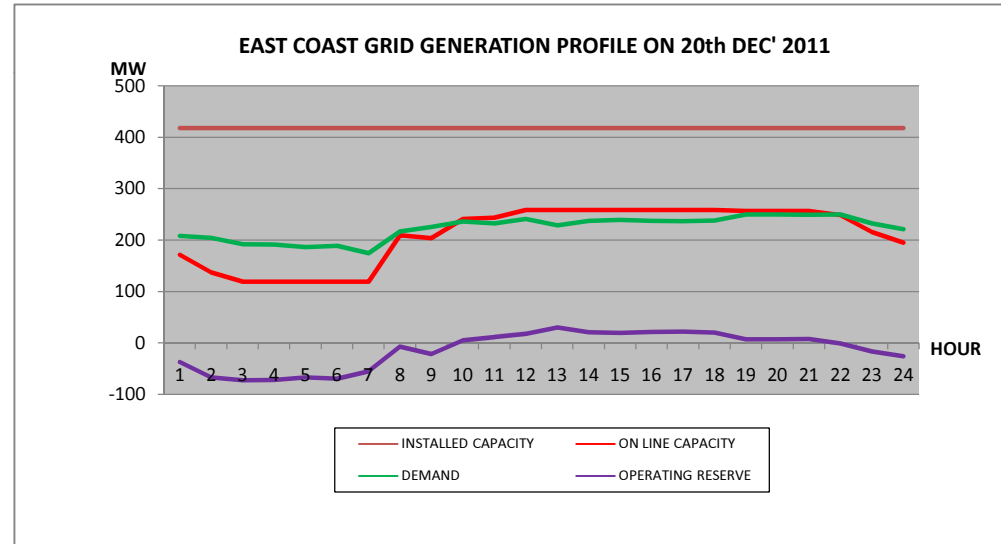

**WEST COAST GRID**

		<b>1</b>	<b>2</b>	<b>3</b>	<b>4</b>	<b>5</b>	<b>6</b>	<b>7</b>	<b>8</b>	<b>9</b>	<b>10</b>	<b>11</b>	<b>12</b>	<b>13</b>	<b>14</b>	<b>15</b>	<b>16</b>	<b>17</b>	<b>18</b>	<b>19</b>	<b>20</b>	<b>21</b>	<b>22</b>	<b>23</b>	<b>24</b>
<b>INSTALLED CAPACITY</b>		858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5	858.5
<b>ON LINE CAPACITY</b>		517	517	517	517	517	517	528	547	562.7	604.2	582.2	612.7	608.2	608.2	612.7	608.2	590.1	612.1	603.6	581.6	580.5	580.5	571.5	563.5
<b>DEMAND</b>		411.9	409.6	407	400.2	390.3	398.2	391.3	434.2	487.65	508.95	512.75	523.65	513.45	517.45	525.65	526.55	526.5	480.5	513.9	499.1	500.3	485.3	446.2	456
<b>OPERATING RESERVE</b>		105.1	107.4	110	116.8	126.7	118.8	136.7	112.8	75.05	95.25	69.45	89.05	94.75	90.75	87.05	81.65	63.6	131.6	89.7	82.5	80.2	95.2	125.3	107.5
West Cost		33963	33720	33599	33083	32571	32886	33113	37500	41009	41899	41785	41678	41121	41626	42141	42288	42505	39444	40330	40275	40247	39173	35068	34116

